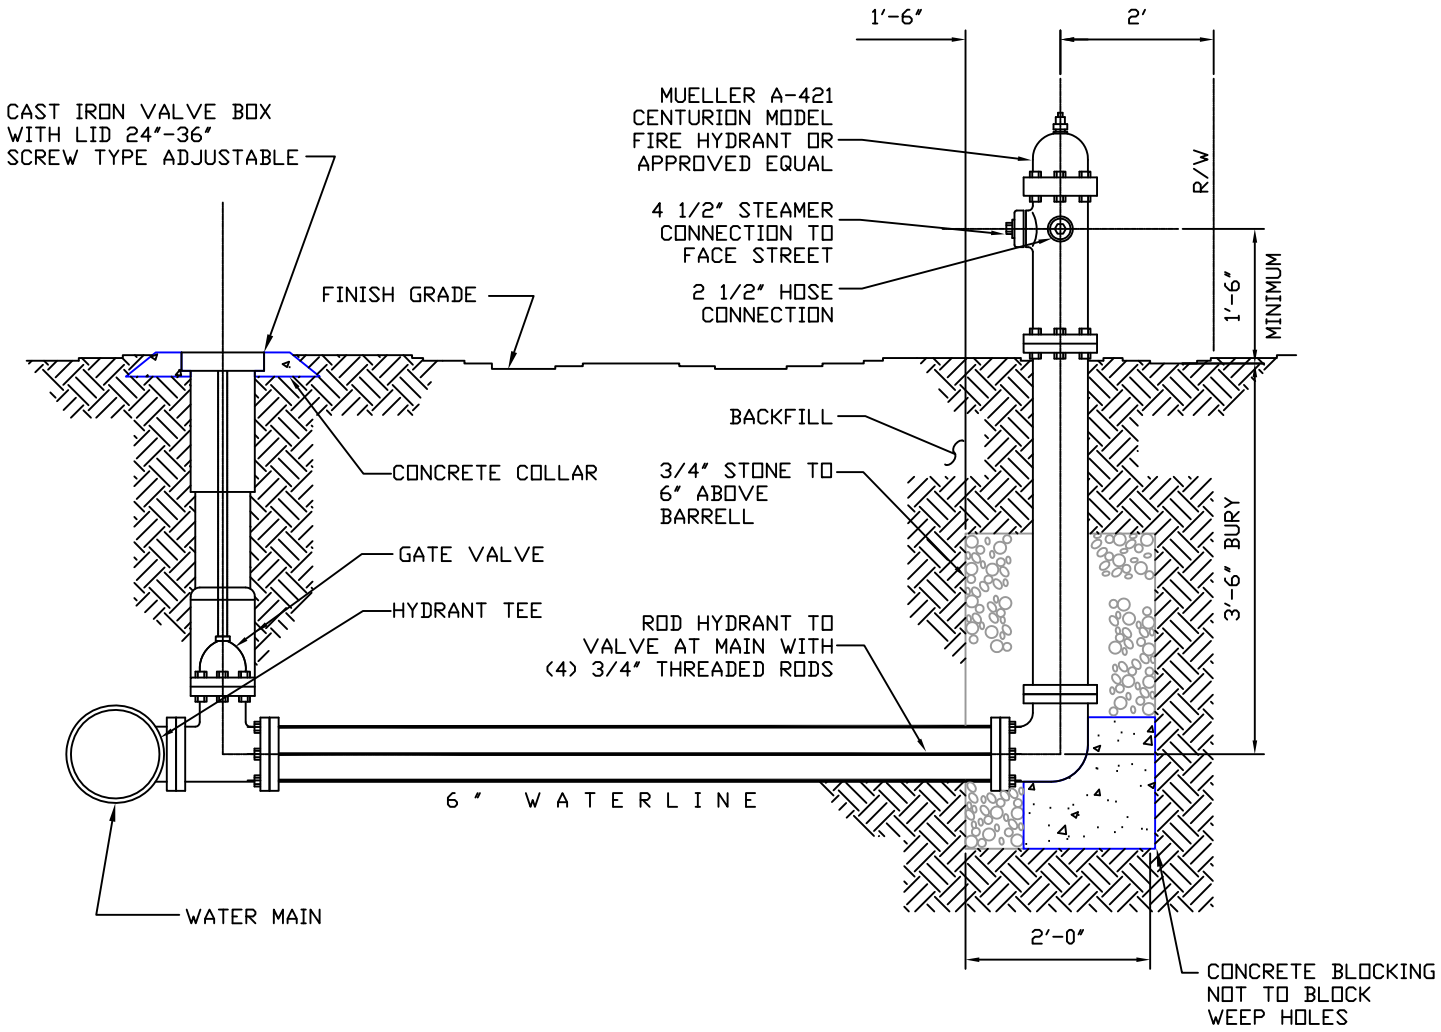

NOTE: HYDRANT SHALL BE STANDARD THREADS OF LOCAL FIRE DEPARTMENT.

ALL HYDRANTS SHALL BE BAGGED AFTER INSTALLATION UNTIL FINAL PROJECT APPROVAL

GEORGETOWN COUNTY WATER & SEWER DISTRICT		
TYPICAL FIRE HYDRANT INSTALLATION - SECTION		
DATE	SCALE	NO. 11 - W
DRAWN	CHECKED	