

EXTEND & LOOP WIRE UP INTO VALVE BOX AND THROUGH TOP OPENING TO ALLOW FOR 12' MIN. IN EXCESS

EXTEND & LOOP WIRE UP BESIDE HYDRANTS MINIMUM OF 12' FOR ATTACHMENT BY LOCATOR DEVICE

TYPICAL FIRE HYDRANT

FINISH GRADE


CONCRETE COLLAR

GATE VALVE & CAST IRON BOX

6" WATERLINE

WATER MAIN

#10 GAUGE COPPER WIRE TO BE SECURED TO SIDE OF PIPE BY STRAPPING OR TAPING TO PIPE AT 6' INTERVALS

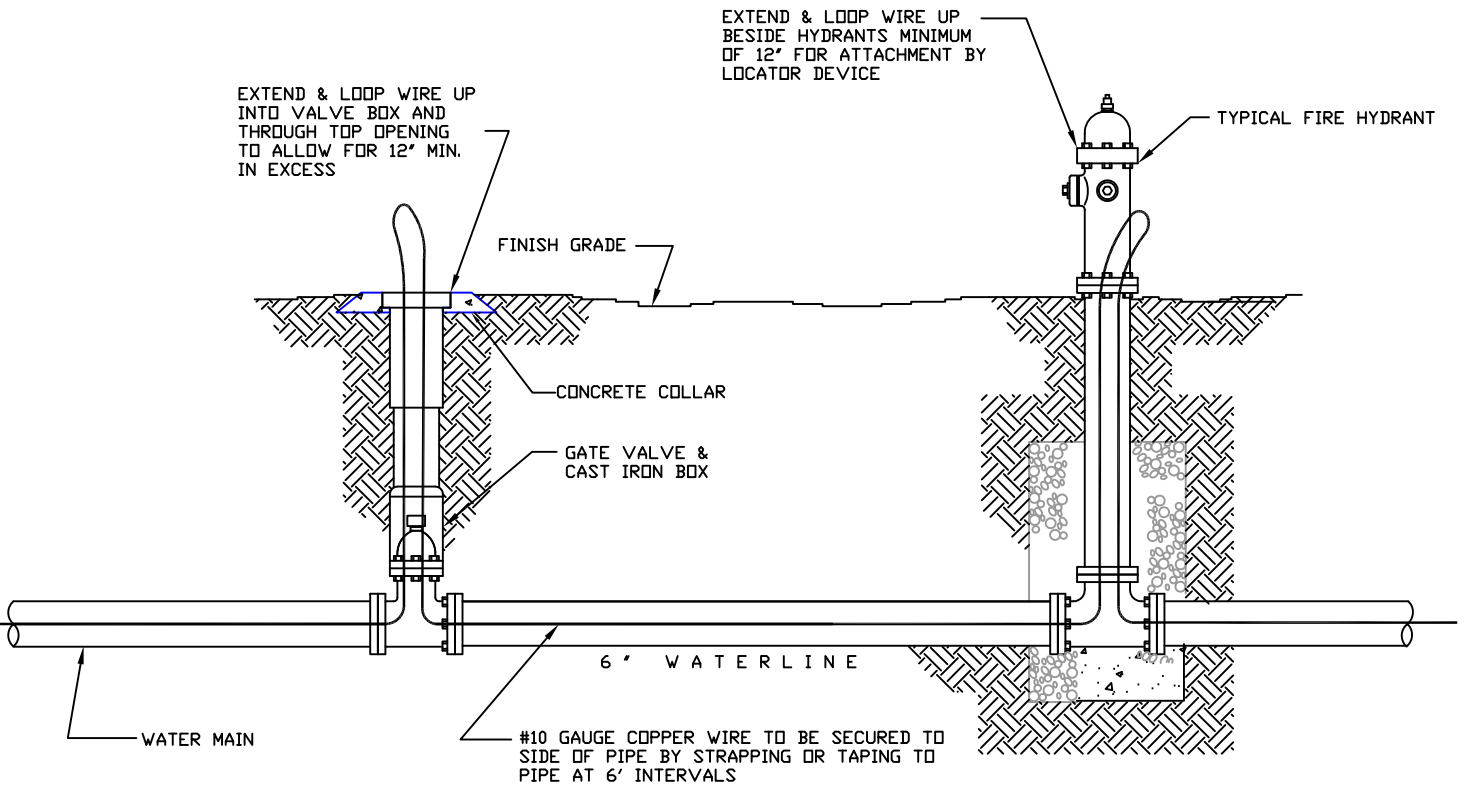

GEORGETOWN COUNTY
WATER & SEWER DISTRICT

TYPICAL LOCATOR WIRE
INSTALLATION - SECTION

DATE 6-26-00	SCALE N.T.S.	NO. 12 - W
DRAWN C.L.E.	CHECKED	